



**NOTES**

1. FIRE DAMPER TO BE INSTALLED COMPLETE WITH HEVAGANCA MOUNTING FRAME FIXED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
2. IN PLANTROOMS AND OTHER AREAS WHERE AN UPSTAND IS POSSIBLE, THE DAMPER FRAME MAY BE BUILT INTO A CAST CONCRETE UPSTAND.

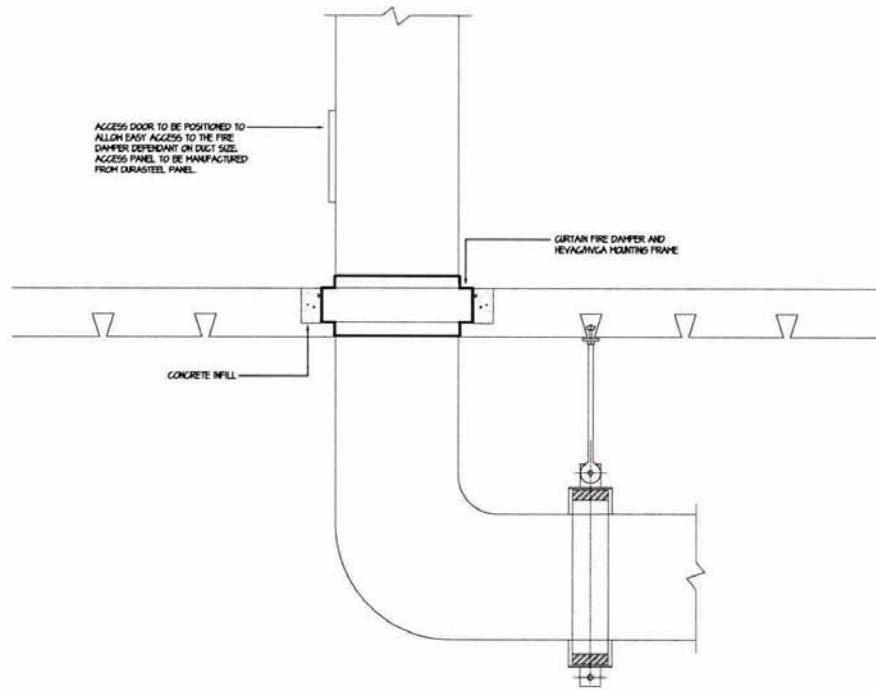

FLOOR PENETRATION

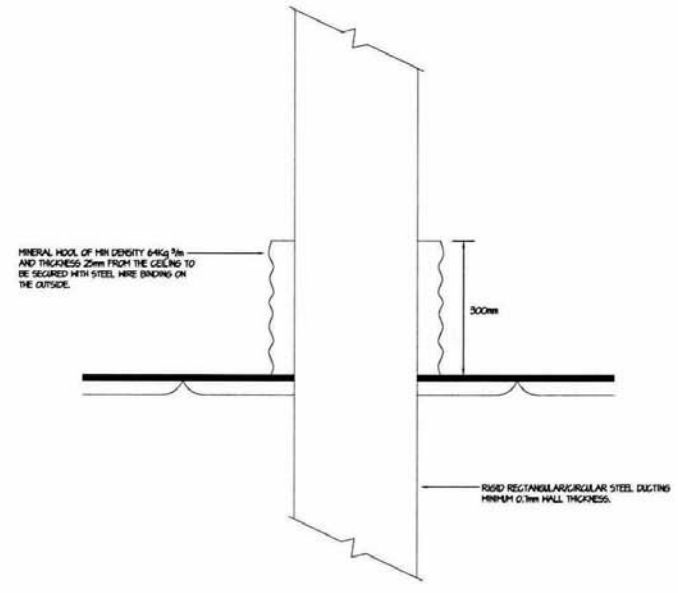

CEILING PENETRATION

PROJECT  
6M OFORD METHOD

DRAWING TITLE  
DUCTWORK FIRE PROTECTION AT FLOOR AND CEILING PENETRATIONS

SCALE: NTS DATE: JUNE 2004 BY: BF, VL, MC

FIGS: 8 DRAWING NUMBER: 04041/6M/M06 KEY